



Primary Engineering, Inc.
2828 Lake Ave.
Fort Wayne, Indiana 46805
260-424-0444 ph
www.primary-eng.com



Addendum: 2

Date: 1/15/2026

Project: FWCS 2026 Electrical Projects


Comm #: 25778

The following items shall be incorporated into the specifications and drawings and are considered to be integral to the bid documents for the project. Acknowledgement of receipt of this addendum is required on the bid form.

Item #1: Drawing Sheet FR-201, FIRST FLOOR PARTIAL POWER DEMOLITION AND NEW PLAN


- A. Emergency (EM1) fixtures added to Franke Park boiler room. Refer to supplemental drawing FR-201 for more information.

**FORT WAYNE COMMUNITY SCHOOLS
 2026 ELECTRICAL PROJECTS
 FORT WAYNE, INDIANA**




DATE: 12-23-2025
 COMM: 25778
 FILE: 778-2-FR-E201
 SCHOOL: Franke Park Elementary School
 828 Mildred Ave.
 Fort Wayne Indiana 46808

TITLE:
**FIRST FLOOR PARTIAL
 POWER DEMOLITION AND
 NEW PLAN**
 SHEET:
**FR-
 E201**

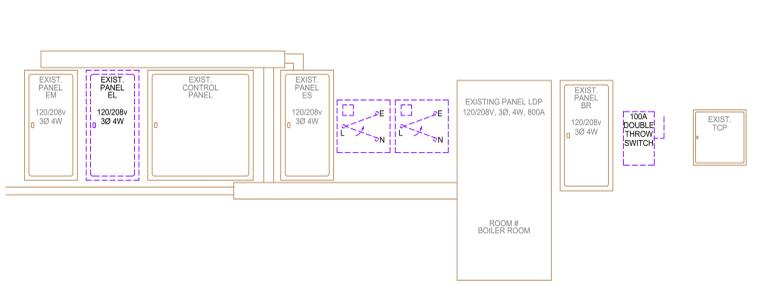

3 DEMOLITION ELECTRICAL PARTIAL RISER DIAGRAM - BOILER ROOM WALL
 NOT TO SCALE

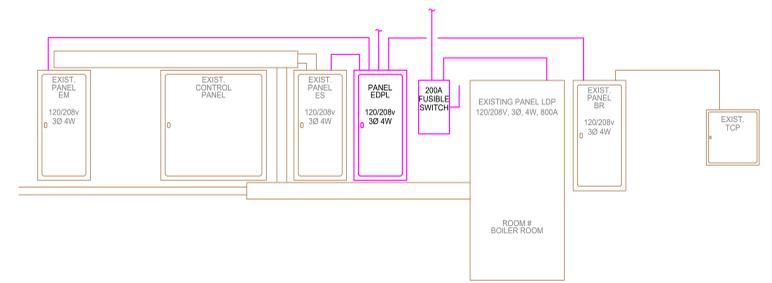


4 NEW ELECTRICAL PARTIAL RISER DIAGRAM - BOILER ROOM WALL
 NOT TO SCALE


- DEMOLITION PLAN NOTES**
- DISCONNECT AND REMOVE TRANSFER SWITCHES AND ASSOCIATED CONDUIT AND CONDUCTORS COMPLETE. PREPARE SPACE FOR NEW PANEL AND CONNECTIONS TO EXISTING EMERGENCY PANEL(S).
 - DISCONNECT AND REMOVE GENERATOR AND ASSOCIATED DEVICES, CONDUIT AND CONDUCTORS COMPLETE. REMOVE EXISTING NATURAL GAS LINE SERVING GENERATOR COMPLETE INCLUDING ALL ASSOCIATED MOUNTING DEVICE HANGERS BACK TO EXISTING VALVE AT MAIN AND CAP. COORDINATE WITH OWNER PRIOR TO DISCONNECTION AND REMOVAL.
 - DISCONNECT AND REMOVE EXISTING LIGHT FIXTURES SERVING AREA. EXISTING LIGHTING CIRCUITRY SERVING AREA TO REMAIN. PREPARE CONDUIT AND CONDUCTORS TO BE INTERCEPTED AND EXTENDED AS REQUIRED FOR NEW LIGHT FIXTURES.

- PLAN NOTES**
- PROVIDE AND INSTALL NEMA 3R 60V 200A DOUBLE THROW SWITCH. CONNECT TO PANEL "LDP" THROUGH FUSIBLE SWITCH AND HORIZONTAL TAPPING OF BUS. CONNECT TO NEW PANEL "EDPL" USING 2 1/2" CONDUIT AND 4-#30, 1-#4 GROUND.
 - PROVIDE AND INSTALL 4P, 4W WEATHER PROOF PIN AND SLEEVE RECEPTACLE, TAP BOX, ADJACENT TO DOUBLE THROW SWITCH. REFER TO RISER DIAGRAM FOR ADDITIONAL INFORMATION.
 - PROVIDE AND INSTALL 200A 120/208V 3PH 4W ELECTRICAL PANEL "EDPL". CONNECT TO DOUBLE THROW SWITCH USING 2 1/2" CONDUIT AND 4-#30, 1-#4 GROUND. TAP AND BOLT ON TO HORIZONTAL BUS OF "LDP" AND CONNECT TO 200A FUSIBLE SWITCH AND DOUBLE THROW SWITCH. REFER TO RISER DIAGRAM FOR ADDITIONAL INFORMATION.
 - CONNECT EXISTING EMERGENCY PANELS "EM", "ES" AND "BR" TO NEW PANEL "EDPL". REFER TO PANEL SCHEDULE AND RISER DIAGRAM FOR ADDITIONAL INFORMATION.
 - INTERCEPT AND RELOCATE EXISTING HOT WATER PUMPS P-4 AND P-5 (10 HP EACH) TO PANEL "BR". CONNECT USING 1" CONDUIT AND 3-#6, 1-#10 GROUND. PROVIDE AND INSTALL NEW (2) 208V 60A/3P CIRCUIT BREAKERS, ONE FOR EACH PUMP. DISCONNECT EXISTING 20A/1P SPARES, AS REQUIRED, AND TURN OVER TO OWNER. DISCONNECT AND REMOVE EXISTING DOUBLE THROW SWITCH SERVING PUMPS PRIOR TO CIRCUIT RELOCATION.
 - INTERCEPT, EXTEND AND RELOCATE EXISTING BOILER B-1 TO PANEL "BR". CONNECT USING 3/4" CONDUIT AND 3-#10, 1-#12 GROUND. PROVIDE AND INSTALL NEW 20A/1P CIRCUIT BREAKER IN AVAILABLE SPACE. DISCONNECT EXISTING 20A/1P SPARES, AS REQUIRED, AND TURN OVER TO OWNER.
 - INTERCEPT, EXTEND AND RELOCATE EXISTING CIRCUITRY AND ASSOCIATED 30A/3P SERVING PUMP-3 IN PANEL "BR" TO PANEL "ES". PROVIDE ALL NECESSARY MATERIALS FOR COMPLETE CONNECTION AT NEW PANEL LOCATION.
 - PROVIDE AND INSTALL NEW LIGHT FIXTURE(S) IN EXISTING LOCATION(S). CONNECT EXISTING LIGHTING CIRCUITRY SERVING AREA. INTERCEPT AND CONNECT EXISTING LIGHTING CIRCUIT(S) SERVING BOILER ROOM TO PANEL "EM". CONNECT USING 3/4" CONDUIT AND 2-#12, 1-#10 GROUND. PROVIDE AND INSTALL NEW 20A/1P CIRCUIT BREAKER IN AVAILABLE SPACE.
 - CONNECT EMERGENCY EGRESS LIGHTING TO ROOM LIGHTING CIRCUIT UNSWITCHED PER NEC.

- E.C. SHALL VERIFY ALL EXISTING CIRCUITS IN PANELS WHERE CHANGES ARE MADE. PROVIDE NEW, TYPED, UPDATED DIRECTORY.
- PATCH ALL SURFACES PREVIOUSLY COVERED BY SURFACE RACEWAY, WITH MATCHING MATERIAL, AS REQUIRED TO MATCH EXISTING WALL. PAINT BY OWNER.
- E.C. SHALL HAND OVER ALL FABRICATED COVER PLATES TO OWNER TO BE PAINTED PRIOR TO INSTALLATION, AS REQUIRED.
- COORDINATE ALL WORK WITH OTHER TRADES ONSITE.

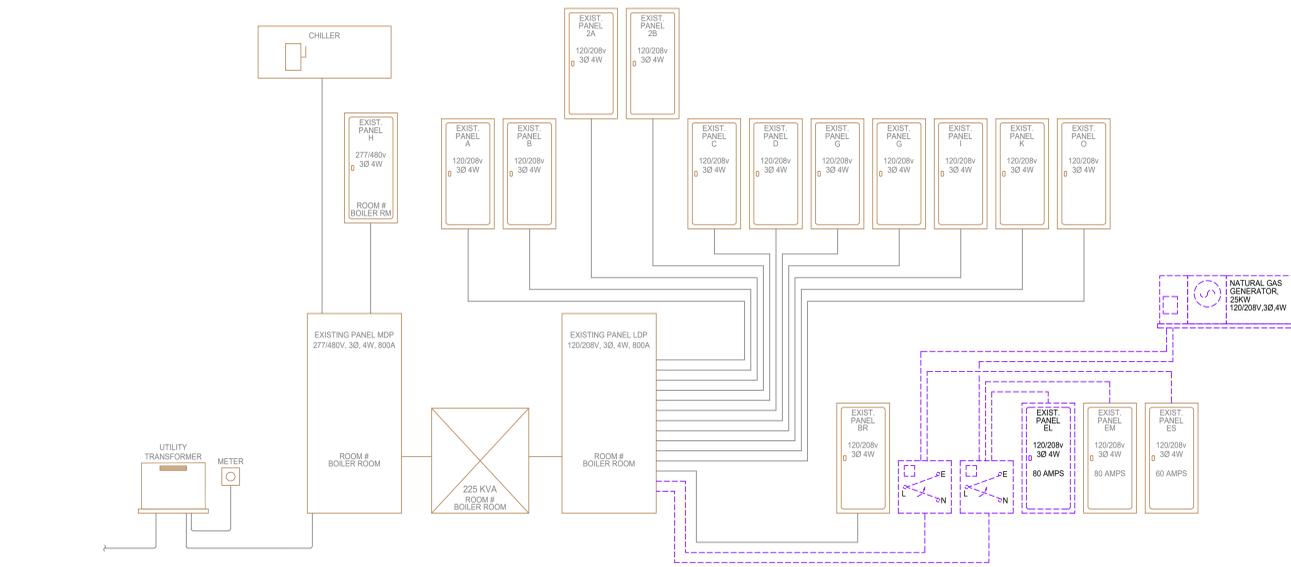


1 DEMOLITION ELECTRICAL RISER DIAGRAM
 NOT TO SCALE

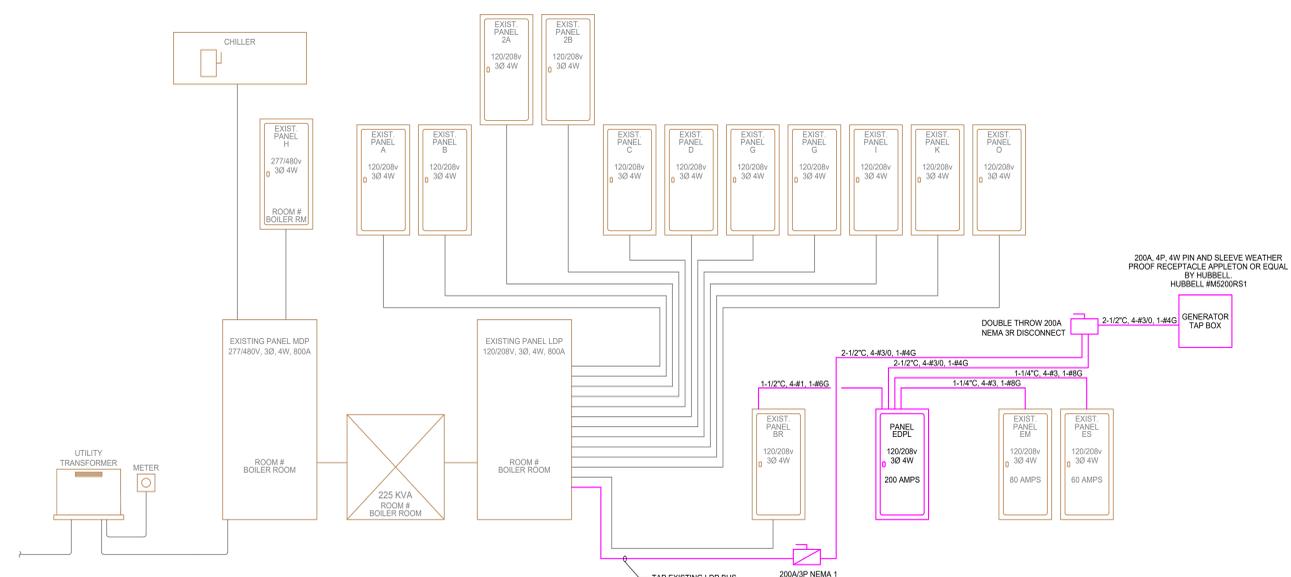

- NOTES:**
- TAP BUS AND PROVIDE CONNECTOR AND MATERIALS AS REQUIRED.
 - COORDINATE MOUNTING ON UNIT ACCORDING TO MANUFACTURER SHOP DRAWINGS

2 NEW ELECTRICAL RISER DIAGRAM
 NOT TO SCALE

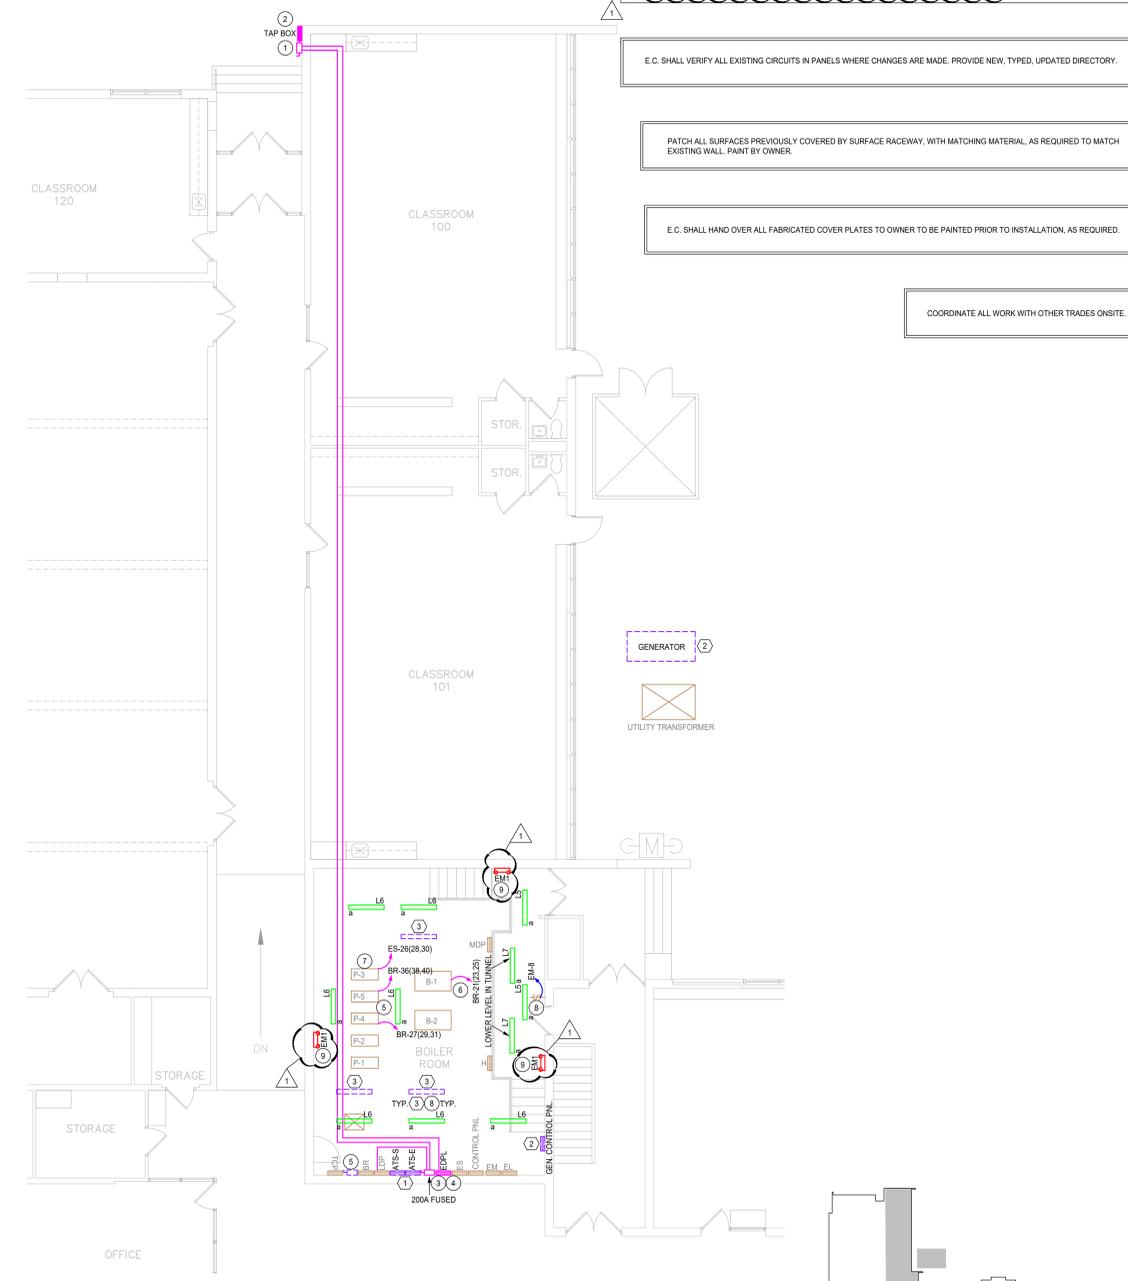

FIRST FLOOR PARTIAL POWER DEMOLITION AND NEW PLAN
 SCALE: 1/8" = 1'-0"



File Location: S:\2025\778-2026 Electrical Projects\Drawings\Sheet Name: 778-2-FR-E201.dwg Date Printed: 12/24/2025 10:24:19 AM Printed by: C:\Users\mccoy\Documents\Primary Engineering Inc